


BK1060CS.20

**LOW WIND LOAD**  
**WIND LOAD 90 MPH**

1/2"x1 1/2" DEAD SOFT ALUM. RETAINER  
ATTACHED WITH (2)  
# 8 S.M. SCREWS @ EACH  
SIDE OF THE SEAM, THEN @  
14" CENTERS ALL AROUND  
PERIMETER OF RETAINER

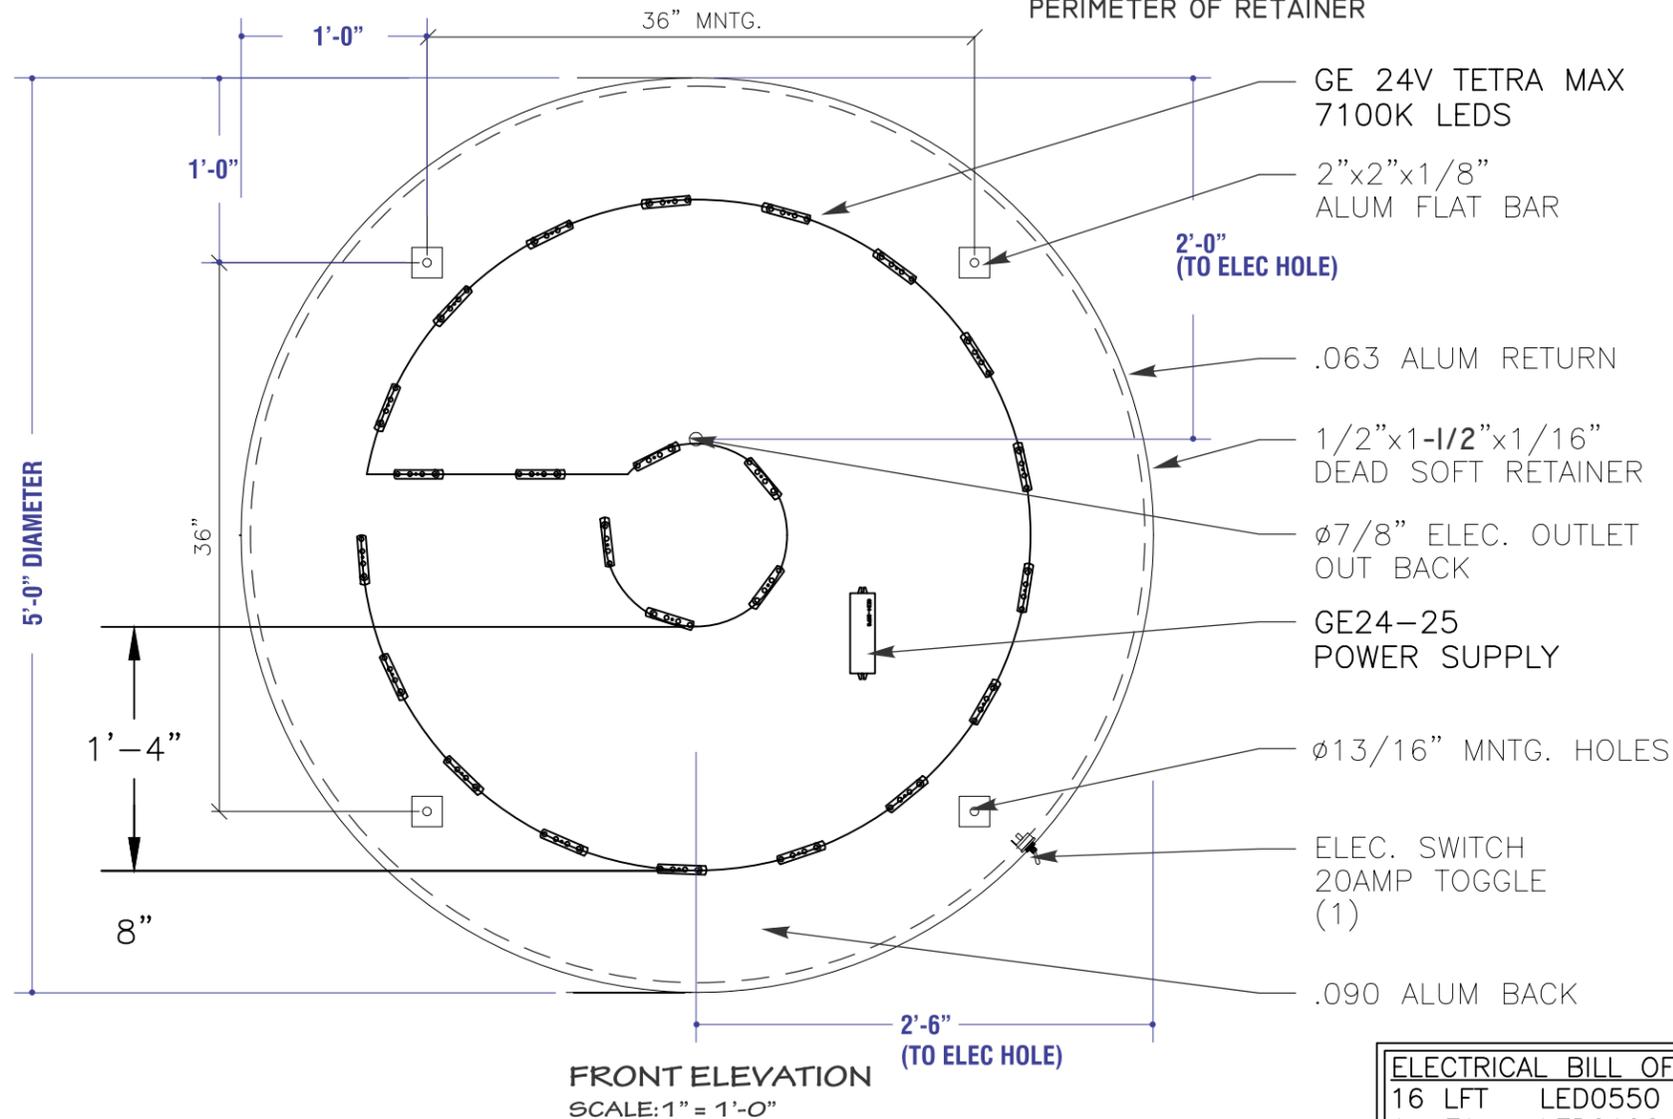

ELECTRICAL REQUIREMENTS	
Total:	.3 Amps
<b>1 - 120V - 20A Circuits Req'd</b>	
ALL BRANCH CIRCUITS SHALL BE DEDICATED TO SIGNS (INCLUDING GROUND AND NEUTRAL) AND SHALL NOT BE SHARED WITH OTHER LOADS.	

ELECTRICAL BILL OF MATERIAL:		
16 LFT	LED0550	TETRA MAX 24V 7100K LEDS
1 EA	LED0106	GEPS24-25 PS
1 EA	ELT0041	DISCONNECT SWITCH
4 LFT	ELT0089	1/2" CARFLEX
1 EA	ELT0092	SEALTITE CONNECTOR



POWERED BY: **24 VOLT MODULES & POWER SUPPLIES**



**General Electric L.E.D.'s**

FILE NAME: BK1060CS.20\_60 DIA SF GE 24V LED CABINET

**BK1060CS.20**



**VISUAL COMMUNICATIONS**

www.FederalHeath.com

12704 DuPont Circle Tampa, FL 33626

(813) 855-4415 (800) 284-3284 Fax (813) 854-3037

Building Quality Signage Since 1901

Manufacturing Facilities:  
Oceanside, CA - Eules, TX - Jacksonville, TX  
Delaware, OH - Racine, WI

Office Locations:  
Oceanside, CA - Las Vegas, NV - Laughlin, AZ  
Idaho Falls, ID - Eules, TX - Jacksonville, TX - San Antonio, TX  
Houston, TX - Corpus Christi, TX - Indianapolis, IN  
Louisville, KY - Knoxville, TN - Grafton, WI - Delaware, OH  
Willowbrook, IL - Tunica, MS - Atlanta, GA  
Tampa, FL - Daytona Beach, FL - Orlando, FL

Revisions: **R1 JCR 3/19/20 NEW SITE PLAN & ELEVATIONS**

**R2 JCR 3/20/20 ADD SIGN "F"**

**R3 JK 5/21/20 ADD ADDITIONAL SPECIFICATIONS FOR MONUMENT SIGN (F)**

**R4 JK 6/05/20 CONFIRM SIGN E IS TO SCALE AND NOTE.**

Colors Depicted In This Rendering May Not Match Actual Finished Materials. Refer To Product Samples For Exact Color Match.

Client Approval/Date: \_\_\_\_\_

Landlord Approval/Date: \_\_\_\_\_

Account Rep: **Fiona Paul**

Project Manager: **Jeremy Moore**

Drawn By: **Jesthan Delcano/CHC**

Underwriters Laboratories Inc. ELECTRICAL TO USE U.L. LISTED COMPONENTS AND SHALL MEET ALL N.E.C. STANDARDS  
ALL ELECTRICAL SIGNS ARE TO COMPLY WITH U.L. 48 AND ARTICLE 600 OF THE N.E.C. STANDARDS, INCLUDING THE PROPER GROUNDING AND BONDING OF ALL SIGNS.

Project / Location:



Store#: 1366  
317 MAIN ST  
MADISON, NJ 07940

Job Number: **23-55534-10**

Date: **September 06, 2019**

Sheet Number: **6** Of **16**

Design Number: **23-55534-10 R4**

This original drawing is provided as part of a planned project and is not to be exhibited, copied or reproduced without the written permission of Federal Heath Sign Company, LLC or its authorized agent. © FHSC